


1-2. Dimensional Data




(A) Indoor Units: S-36PU2E5A / S-45PU2E5A / S-50PU2E5A / S-60PU2E5A / S-71PU2E5A

unit: mm

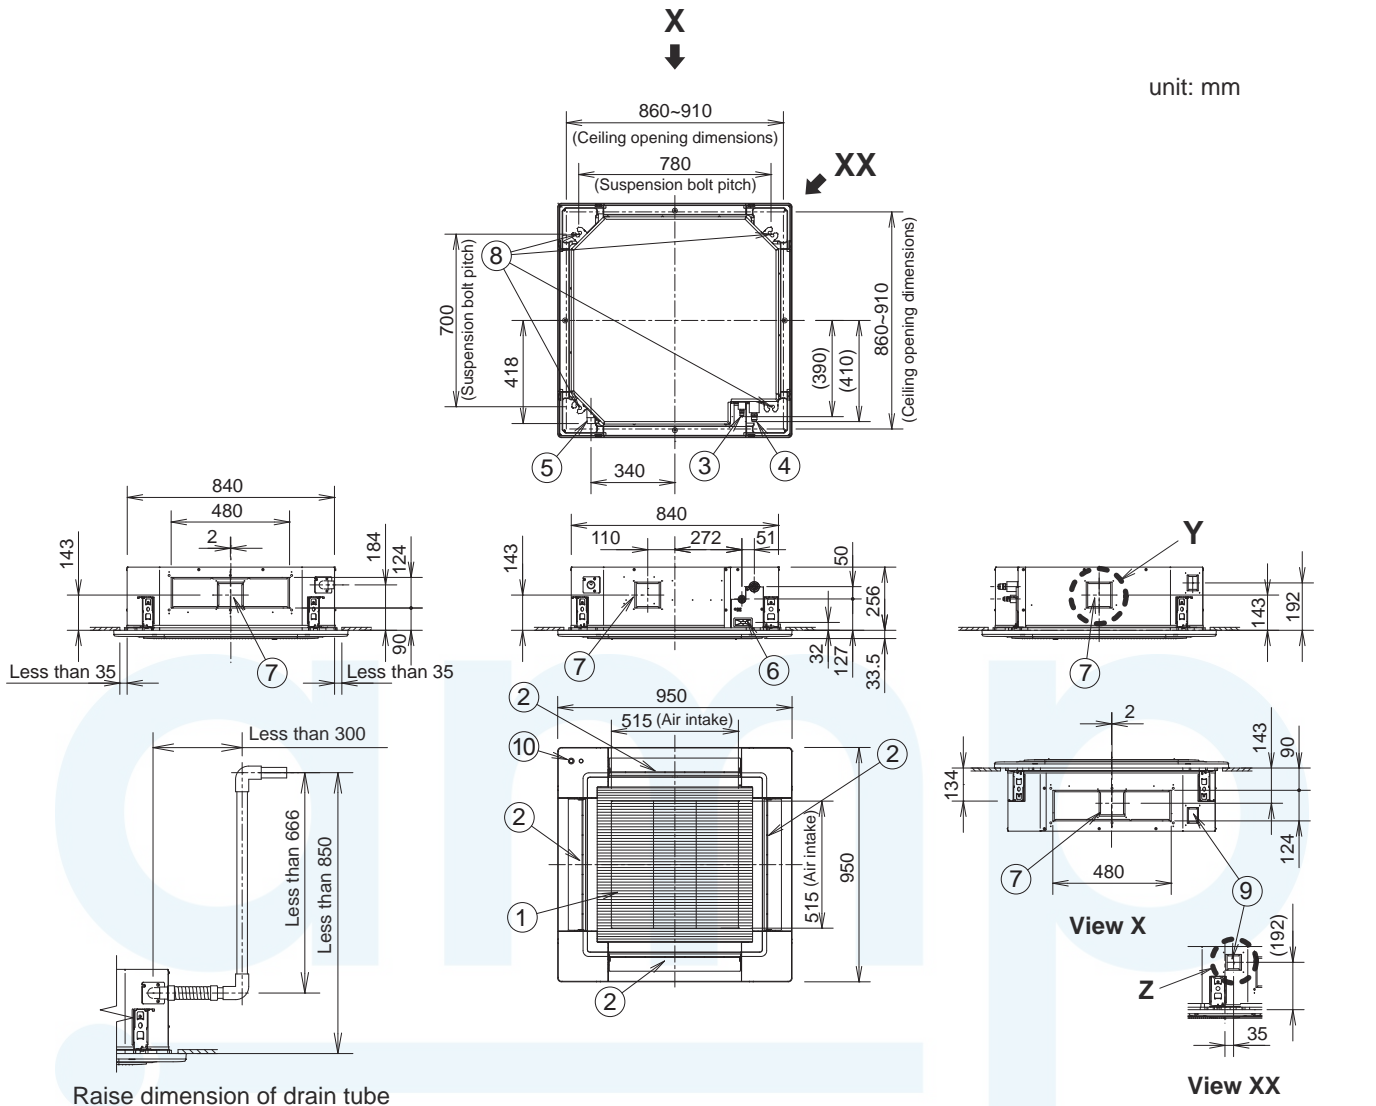

Raise dimension of drain tube

The length of the suspension bolts should be selected so that there is a gap of 30 mm or more below the lower surface of the ceiling (18 mm or more below the lower surface of the main unit), as shown in the figure at right. If the suspension bolt is too long, it will contact the ceiling panel and the unit cannot be installed.

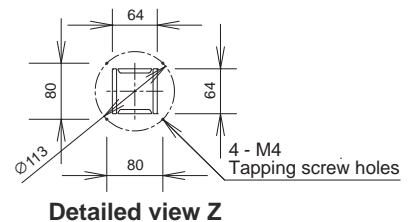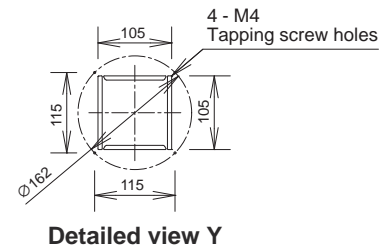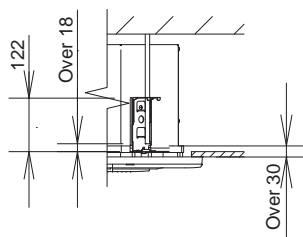

①	Air intake
②	Discharge outlet
③	Refrigerant tubing (liquid tube) 36-50 type $\varnothing 6.35$ (flared), 60 • 71 type $\varnothing 9.52$ (flared)
④	Refrigerant tubing (gas tube) 36-50 type $\varnothing 12.7$ (flared), 60 • 71 type $\varnothing 15.88$ (flared)
⑤	Drain tube connection port VP25 (outer dia. $\varnothing 32$)
⑥	Power supply port
⑦	Discharge duct connection port ($\varnothing 150$)
⑧	Suspension bolt hole (4-12x30 elongated hole)
⑨	Fresh air intake duct connection port ($\varnothing 100$) *
⑩	ECONAVI sensor (Only CZ-KPU3A)

* Necessary to attach duct connecting flange(field supplied).

<Filter dimension>
520 x 520 x 15